

Shell boilers —

Part 10: Requirements for feedwater and boiler water quality

The European Standard EN 12953-10:2003 has the status of a
British Standard

ICS 13.060.25; 27.060.30; 27.100

National foreword

This British Standard is the official English language version of EN 12953-10:2003.

When reference to this part of the European Standard has been published in the Official Journal of the European Communities (OJ), compliance with it will confer a presumption of conformity with the essential safety requirements of the Pressure Equipment Directive covered by this part of the standard.

The UK participation in its preparation was entrusted to Technical Committee PVE/16, Shell boilers, which has the responsibility to:

- aid enquirers to understand the text;
- present to the responsible international/European committee any enquiries on the interpretation, or proposals for change, and keep the UK interests informed;
- monitor related international and European developments and promulgate them in the UK.

A list of organizations represented on this committee can be obtained on request to its secretary.

Cross-references

The British Standards which implement international or European publications referred to in this document may be found in the *BSI Catalogue* under the section entitled “International Standards Correspondence Index”, or by using the “Search” facility of the *BSI Electronic Catalogue* or of British Standards Online.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, the EN title page, pages 2 to 13 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

Amendments issued since publication

Amd. No.	Date	Comments

This British Standard, was published under the authority of the Standards Policy and Strategy Committee on 14 October 2003

© BSI 14 October 2003

ISBN 0 580 42759 5

ICS 13.060.25; 27.060.30; 27.100

English version

Shell boilers - Part 10 : Requirements for feedwater and boiler water quality

Chaudières à tubes à fumée - Partie 10 : Exigences relatives à la qualité de l'eau d'alimentation et de l'eau en chaudière

Großwasserraumkessel - Teil 10 : Anforderungen an die Speisewasser- und Kesselwasserqualität

This European Standard was approved by CEN on 4 August 2003.

CEN members are bound to comply with the CEN/CENELEC Internal Regulations which stipulate the conditions for giving this European Standard the status of a national standard without any alteration. Up-to-date lists and bibliographical references concerning such national standards may be obtained on application to the Management Centre or to any CEN member.

This European Standard exists in three official versions (English, French, German). A version in any other language made by translation under the responsibility of a CEN member into its own language and notified to the Management Centre has the same status as the official versions.

CEN members are the national standards bodies of Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and United Kingdom.



EUROPEAN COMMITTEE FOR STANDARDIZATION
COMITÉ EUROPÉEN DE NORMALISATION
EUROPÄISCHES KOMITEE FÜR NORMUNG

Management Centre: rue de Stassart, 36 B-1050 Brussels

Contents

page

Foreword.....3

1 Scope4

2 Normative references4

3 Terms and definitions.....5

4 Conditioning5

5 Requirements6

6 Test of the chemical composition10

6.1 General.....10

6.2 Sampling11

6.3 Sampling points11

7 Analysis11

7.1 General.....11

7.2 Visual criteria.....11

7.3 Analysis methods12

Bibliography13

Foreword

This document (EN 12953-10:2003) has been prepared by Technical Committee CEN /TC 269, "Shell and water-tube boilers", the secretariat of which is held by DIN.

This European Standard shall be given the status of a national standard, either by publication of an identical text or by endorsement, at the latest by March 2004, and conflicting national standards shall be withdrawn at the latest by March 2004.

The European Standard EN 12953 concerning shell boilers consists of the following Parts:

- *Part 1: General*
- *Part 2: Materials for pressure parts of boilers and accessories*
- *Part 3: Design and calculation for pressure parts*
- *Part 4: Workmanship and construction of pressure parts of the boiler*
- *Part 5: Inspection during construction, documentation and marking of pressure parts of the boiler*
- *Part 6: Requirements for equipment for the boiler*
- *Part 7: Requirements for firing systems for liquid and gaseous fuels for the boiler*
- *Part 8: Requirements for safeguards against excessive pressure*
- *Part 9: Requirements for limiting devices of the boiler and accessories*
- *Part 10: Requirements for feedwater and boiler water quality*
- *Part 11: Acceptance tests*
- *Part 12: Requirements for grate firing systems for solid fuels for the boiler*
- *Part 13: Operating instructions*

CR 12953 Part 14: *Guideline for the involvement of an inspection body independent of the manufacturer*

According to the CEN/CENELEC Internal Regulations, the national standards organizations of the following countries are bound to implement this European Standard: Austria, Belgium, Czech Republic, Denmark, Finland, France, Germany, Greece, Hungary, Iceland, Ireland, Italy, Luxembourg, Malta, Netherlands, Norway, Portugal, Slovakia, Spain, Sweden, Switzerland and the United Kingdom.

1 Scope

This Part of this European Standard applies to all shell boilers as defined in EN 12953-1 which are heated by combustion of one or more fuels or by hot gases for the generation of steam and/or hot water.

This Part of this European Standard applies to those components between the feedwater inlet and the steam outlet of the steam generator. The quality of the steam produced is outside the scope of this standard.

This Part of this European Standard aims to ensure that the boiler is able to be operated to minimize risk to personnel, the boiler and associated plant components located near it.

NOTE 1 This part of this European Standard does not aim to achieve optimum economic operation. For certain purposes, it will be more appropriate to optimize the chemical characteristics in order to:

- increase the thermal efficiency;
- increase the availability and reliability of the plant;
- increase the steam purity;
- reduce the maintenance costs – repair, chemical cleaning, etc.

This Part of this European Standard sets out minimum requirements for the specific types of water to reduce the risk of corrosion, sludge precipitation or formation of deposits which may lead to any damage or other operating problems.

NOTE 2 This Part of this European Standard has been prepared on the assumption that the user of this European Standard possesses a sufficient knowledge of the construction and operation of the boiler as well as an adequate appreciation of water and steam chemistry.

2 Normative references

This European Standard incorporates, by dated or undated reference, provisions from other publications. These normative references are cited at the appropriate places in the text, and the publications are listed hereafter. For dated references, subsequent amendments to or revisions of any of these publications apply to this European Standard only when incorporated in it by amendment or revision. For undated references, the latest edition of the publication referred to applies (including amendments).

EN 12953-1:2002, *Shell boilers — Part 1: General*.

EN ISO 9963-1, *Water quality — Determination of alkalinity — Part 1: Determination of total and composite alkalinity (ISO 9963-1:1994)*.

ISO 5667-1, *Water quality — Sampling — Part 1: Guidance on the design of sampling programmes*.

ISO 5667-3, *Water quality — Sampling — Part 3: Guidance on the preservation and handling of samples*.

ISO 5814, *Water quality — Determination of dissolved oxygen — Electrochemical probe method*.

ISO 6059, *Water quality — Determination of the sum of calcium and magnesium — EDTA titrimetric method*.

ISO 6332, *Water quality — Determination of iron — Spectrometric method using 1,10-phenanthroline*.

ISO 6878, *Water quality — Spectrometric determination of phosphorus using ammonium molybdate*.

ISO 7888, *Water quality — Determination of electrical conductivity*.

ISO 8245, *Water quality — Guidelines for the determination of total organic carbon (TOC) and dissolved organic carbon (DOC)*.

ISO 8288, *Water quality — Determination of cobalt, nickel, copper, zinc, cadmium and lead — Flame atomic absorption spectrometric methods*.

ISO 9964-1, *Water quality — Determination of sodium and potassium — Part 1: Determination of sodium by atomic absorption spectrometry*.

ISO 9964-2, *Water quality — Determination of sodium and potassium — Part 2: Determination of potassium by atomic absorption spectrometry*.

ISO 10523, *Water quality — Determination of pH*.

3 Terms and definitions

For the purpose of this part of this European Standard, the terms and definitions given in EN 12953-1:2002 and the following definitions apply.

3.1

direct conductivity

direct measured conductivity of water

3.2

acid conductivity

conductivity of water measured in the hydrogenion concentration from continuously flow through downstream of a strongly acidic cation exchanger

3.3

make-up water

water which compensates for losses of water and steam from the system

3.4

feedwater

mixture of returned condensate and/or make up water supplied to the boiler inlet

3.5

demineralized feedwater

water with an electrolyte content according to an acid conductivity of $< 0,2 \mu\text{S}/\text{cm}$ and a silica content (SiO_2) $< 0,02 \text{ mg}/\text{l}$

3.6

boiler water

water within a natural or assisted circulation boiler

3.7

attemperor spray water

water for injection to control steam temperature

4 Conditioning

Certain quality characteristics of feedwater and boiler water shall be improved by treatment with chemicals.

This conditioning can contribute:

- to support the formation of magnetite layers or other protective oxide layers;
- to minimize corrosion by optimizing the pH value;

- to stabilize hardness and to prevent or minimize scaling;
- to effect chemical oxygen scavenging;
- to develop special coatings with protective effect by film formation on metallic surfaces.

Conventional inorganic conditioning agents include e.g. sodium and potassium hydroxide, sodium phosphate, sodium sulphite, ammonia and hydrazine.

NOTE 1 The use of some of these chemicals can be restricted in some countries.

However, organic-based conditioning agents have been in use for many years now. If organic-based conditioning agents are used, the quantities and methods for use as well as analysis method shall be specified by the supplier of the chemical products.

NOTE 2 The geometry of shell boilers can give rise to stresses and/or crevices, e. g. at welded or rolled flue tubes to tube sheet joints. Because of evaporation a concentration of dissolved, non-volatile ingredients of the boiler water (salts, solid conditioning agents) will take place. Under such conditions local concentration of alkali can occur which leads to stress corrosion. Therefore, with almost unbuffered feedwater of $< 30 \mu\text{S}/\text{cm}$ conductivity, alkalizing with sodium hydroxide is permissible only if the recommended pH range cannot be obtained with sodium phosphate alone. In this case, the pH value will have quick variations with low level of sodium hydroxide.

5 Requirements

5.1 The values for the highest allowable concentrations of a number of impurities and for the maximum and minimum concentrations of chemical agents which are added in order to minimize corrosion, sludge formation and deposits, shall be in accordance with Tables 5-1 and 5-2 and Figures 5-1 and 5-2.

Table 5-1 — Feedwater for steam boilers (except attemperator spray water) and hot water boilers

Parameter	Unit	Feedwater for steam boilers		Make-up water for hot water boilers
		> 0,5 to 20	> 20	
Operating pressure	bar (= 0,1 MPa)	> 0,5 to 20	> 20	total range
Appearance	—	clear, free from suspended solids		
Direct conductivity at 25 °C	µS/cm	not specified, only guide values relevant for boiler water see table 5-2		
pH value at 25 °C ^a	—	> 9,2 ^b	> 9,2 ^b	> 7,0
Total hardness (Ca + Mg)	mmol/l	< 0,01 ^c	< 0,01	< 0,05
Iron (Fe) concentration	mg/l	< 0,3	< 0,1	< 0,2
Copper (Cu) concentration	mg/l	< 0,05	< 0,03	< 0,1
Silica (SiO ₂) concentration	mg/l	not specified, only guide values for boiler water relevant, see table 5-2		—
Oxygen (O ₂) concentration	mg/l	< 0,05 ^d	< 0,02	—
Oil/grease concentration (see EN 12953-6)	mg/l	< 1	< 1	< 1
Organic substances (as TOC) concentration	—	see footnote ^e		

^a With copper alloys in the system the pH value shall be maintained in the range 8,7 to 9,2.

^b With softened water pH value > 7,0 the pH value of boiler water according to table 5-2 should be considered.

^c At operating pressure < 1 bar total hardness max. 0,05 mmol/l shall be acceptable.

^d Instead of observing this value at intermittent operation or operation without deaerator if film forming agents and/or excess of oxygen scavenger shall be used.

^e Organic substances are generally a mixture of several different compounds. The composition of such mixtures and the behaviour of their individual components under the conditions of boiler operation are difficult to predict. Organic substances may be decomposed to form carbonic acid or other acidic decomposition products which increase the acid conductivity and cause corrosion or deposits. They also may lead to foaming and/or priming which shall be kept as low as possible.

Table 5-2 — Boiler water for steam boilers and hot water boilers

Parameter	Unit	Boiler water for steam boilers using			Boiler water for hot water boilers
		Feedwater direct conductivity > 30 $\mu\text{S/cm}$	Feedwater direct conductivity > 20	Feedwater direct conductivity $\leq 30 \mu\text{S/cm}$	
Operating pressure	bar (= 0,1MPa)	> 0,5 to 20	> 20	> 0,5	total range
Appearance	—	clear, no stable foam			
Direct conductivity at 25 °C	$\mu\text{S/cm}$	< 6 000 ^a	see Figure 5-1 ^a	< 1 500	< 1 500
pH value at 25 °C	—	10,5 to 12,0	10,5 to 11,8	10,0 to 11,0 ^{b, c}	9,0 to 11,5 ^d
Composite alkalinity	mmol/l	1 to 15 ^a	1 to 10 ^a	0,1 to 1,0 ^c	< 5
Silica (SiO ₂) concentration	mg/l	pressure dependent, according to figure 5-2			—
Phosphate (PO ₄) ^e	mg/l	10 to 30	10 to 30	6 to 15	—
Organic substances	—	see footnote ^f			—

^a With superheater consider 50 % of the indicated upper value as maximum value.


^b Basic pH adjustment by injecting Na₃PO₄, additional NaOH injection only if the pH value is < 10.

^c If the acid conductivity of the boiler feedwater is < 0,2 $\mu\text{S/cm}$, and its Na + K concentration is < 0,010 mg/l, phosphate injection is not necessary. Under the conditions AVT (all volatile treatment, feedwater pH $\geq 9,2$ and boiler water pH $\geq 8,0$) can be applied, in this case the acid conductivity of the boiler water is < 5 $\mu\text{S/cm}$.

^d If non-ferrous materials are present in the system, e. g. aluminium, they may require lower pH value and direct conductivity, however, the protection of the boiler has priority.

^e If coordinated phosphate treatment is used; considering all other values higher PO₄-concentrations are acceptable (see also clause 4).


^f See ^e in table 5-1.

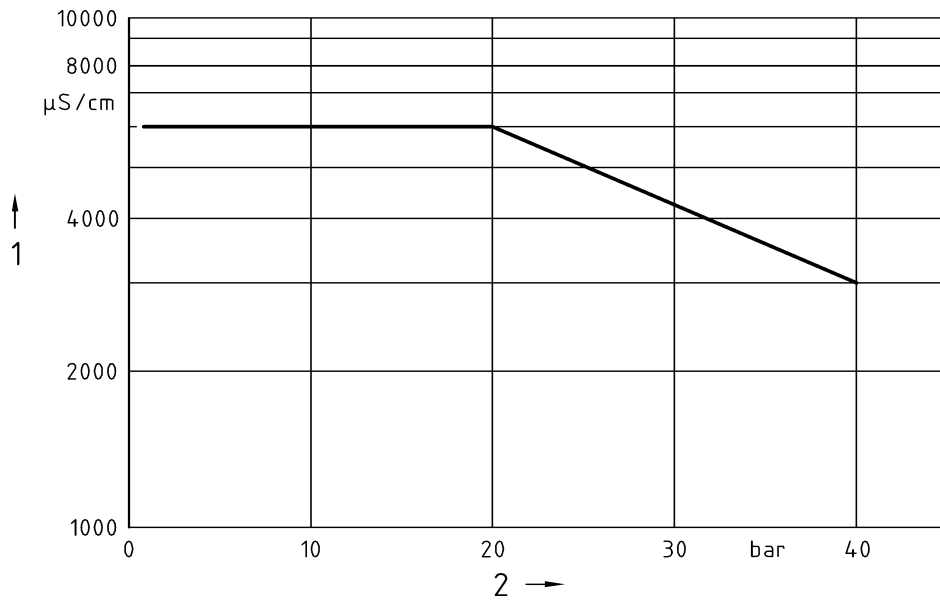

Key

- 1 Direct conductivity
- 2 Operating pressure

Figure 5-1 — Maximum acceptable direct conductivity of the boiler water dependent on the pressure; feedwater direct conductivity > 30 µS/cm

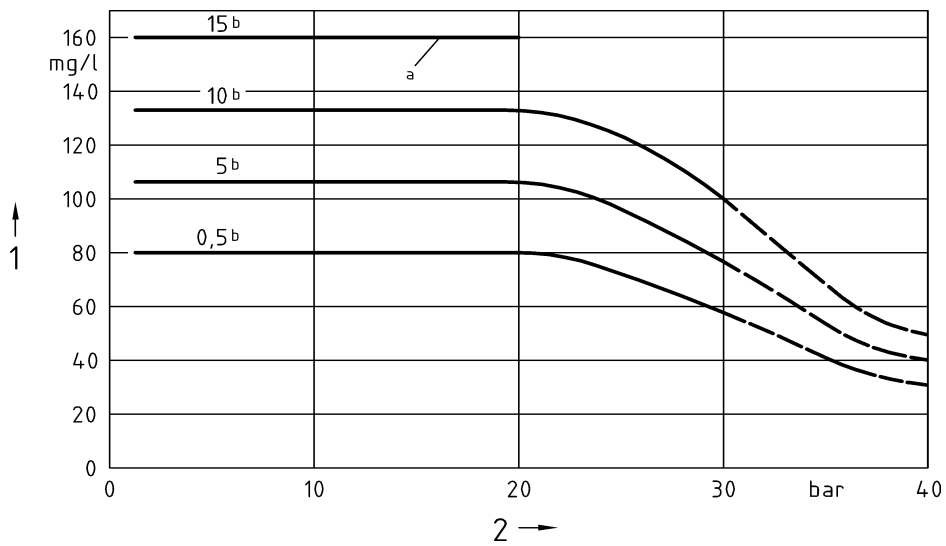

Key

- 1 Maximum silica content
- 2 Operating pressure
- a) This level of alkalinity is not permissible > 20 bar
- b) Alkalinity in mmol/l

Figure 5-2 — Maximum acceptable silica content (SiO₂) of the boiler water dependent on the pressure

5.2 The operating conditions of a boiler and/or the choice of certain materials or special design can cause further limitation to some of the parameters stated in the tables or require specialist advice to set new control parameters. Such special considerations include:

- heated crevices and/or heated phase boundaries;
- operation at pressures much lower than the design value;
- materials other than carbon steel, e. g. stainless steel.

Attemperator spray water for the control of steam temperature shall be demineralized feedwater and/or uncontaminated condensate dosed only with volatile chemicals. It shall not adversely affect the required quality of the steam.

The use to which the steam or hot water will be put, shall necessitate further quality limitations. If applied, for instance, in the food or pharmaceutical industry or fed to steam turbines, special steam quality requirements may be needed. The strictest requirement of the individual application shall be complied with.

5.3 The values stated shall apply to continuous operation. During start-up, shutdown or major operational changes, some values may deviate from the normal value for a short period and to a limited extent depending on the operating parameters and the type of boiler. The extent of any deviation shall be specified by the manufacturer.

The values shall be brought within the continuous operation limits as soon as possible.

When the stated values are deviate during continuous operation this may due to:

- faulty treatment of make-up water;
- insufficient conditioning feedwater;
- contamination of the water caused by in-leakages of impurities from other systems, e. g. condensers, heat exchangers;
- on-going corrosion of certain plant parts.

Appropriate modifications shall be made immediately to secure correct operation. For instance, condensate recycled to feed shall not adversely affect the feedwater quality and shall be polished, if necessary.

The chemical composition of the boiler water in drum boilers can be controlled by dosing of conditioning chemicals as well as by continuous or intermittent blowdown of a proportion of the water volume which shall be done in such a way that both dissolved and suspended impurities can be removed.

6 Test of the chemical composition

6.1 General

To ensure the appropriate chemical conditions prevail, quality parameters shall be checked on a continuous and/or periodical basis.

The feed, boiler and attemperator spray water in steam boilers and the boiler water in hot water boilers shall be checked for the relevant parameters such as pH, direct conductivity, acid conductivity, hardness and oxygen or oxygen scavenger.

The frequency of such testing shall be specified by the manufacturer of the boiler in the operating instructions.

NOTE By using reliable continuous recording analyzers the frequency of manual checks of the water quality can be reduced.

6.2 Sampling

The sampling of water and steam from the boiler system shall be performed in accordance with ISO 5667-1 and the preparation and handling of samples in accordance with ISO 5667-3.

6.3 Sampling points

Sampling points shall be provided at representative locations in the system.

Typical sampling point locations are:

- feedwater from the inlet valve;
- boiler water from a downcomer or from a continuous blowdown line;
- make-up water downstream of the make-up water treatment plant or storage tanks;
- condensate at the outlet of the condenser, if any; otherwise the condensate shall be sampled at a point as near to the feed tank as possible.

7 Analysis

7.1 General

The proof of compliance with the values given in table 5-1 and 5-2 shall be provided in accordance with written procedures applying analysis methods to 7.3, where applicable.

If the analyses are performed according to other standards or by indirect methods, calibrations for the methods shall be made.

NOTE 1 In some types of water the amount of dissolved matter can be estimated from the conductivity. For totally demineralized water, it is possible to derive a pH value from the correlation between the direct and acid conductivities.

NOTE 2 It is preferred that continuously operating monitors for main parameters should be installed. Periodical laboratory checks are essential and are sometimes the only possible test.

7.2 Visual criteria

Changes in the appearance of the water regarding suspended solids, colour or foam can indicate that uncontrolled changes have occurred or are about to occur at the plant.

7.3 Analysis methods

The check of parameters shall be carried out according to the following standards where applicable:

Acid capacity	EN ISO 9963-1
Conductivity	ISO 7888
Copper	ISO 8288
Iron	ISO 6332
Oxygen	ISO 5814
pH	ISO 10523
Phosphate	ISO 6878-1
Potassium	ISO 9964-2
Silica	1)
Sodium	ISO 9964-1
TOC ²⁾	ISO 8245
Total Hardness as Ca + Mg	ISO 6059

Acid conductivity shall be measured in the hydrogenion concentration form continuously in the same way as the conductivity after the sample has passed through a strongly acidic cation exchanger with a volume of a least 1,5 l. The exchanger shall be placed in a cylinder with a diameter to height ratio of 1:3 or less and with exchanger medium in at least three quarters of the cylinder. The ion exchanger shall be regenerated when it is two thirds depleted; this can be seen using an exchanger with an indicator of colour and a transparent cylinder.

1) Up to now no European or International Standard is available, see e. g. DIN 38405-21 German standard methods for the examination of water, waste water and sludge; anions (group D); determination of dissolved silicate by spectrometry (D 21).
2) Alternatively the determination of permanganate index in accordance with ISO 8467 can be measured if values have been specified.

Bibliography

- [1] Directive 97/23/EC of the European Parliament and of the Council of 29 May 1997 on the approximation of the laws of the Member States concerning pressure equipment OJEC, L181.

EN 12953-6, *Shell boilers — Part 6: Requirements for equipment for the boiler.*

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover.
Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001.
Fax: +44 (0)20 8996 7001. Email: orders@bsi-global.com. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre.
Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: info@bsi-global.com.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration.
Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001.
Email: membership@bsi-global.com.

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager.
Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553.
Email: copyright@bsi-global.com.